

### ADDENDUM 1

### ITB TDD 14-19

### Emerald Coast Convention Center- Exterior Restoration

Date of Issue: December 26, 2018

Quote Submittal Deadline: The Bid Date and submission time has NOT CHANGED

Please see the attached 8 pages of drawings and specifications for the proposed project.

## EMERALD COAST CONVENTION CENTER

### RESTORATION PROJECT

1250 MIRACLE STRIP PKWY SE, FORT WALTON BEACH, FL 32548

VICINITY MAP (N.T.S)	

### **CONSTRUCTION NOTES:**

- 1. CONTRACTORS SHALL MAINTAIN PUBLIC ACCESS AT ALL TIMES ALONG RIGHT OF-WAYS.
- 2. NO PARKING OR UNLOADING OF MATERIALS SHALL OCCUR WITHIN PUBLIC RIGHT-OF-WAY.
- 3. CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO STRUCTURES WITHIN THE PUBLIC RIGHT-OF-WAY AND SHALL REPAIR ANY DAMAGE CAUSED BY THE CONSTRUCTION ACTIVITIES TO THE PUBLIC RIGHT-OF-WAY AT THE CONTRACTOR'S EXPENSE.
- 4. CONTRACTOR RESPONSIBLE FOR FIELD VERIFYING ALL MEASUREMENTS AND QUANTITIES. DRAWING FOR REFERENCE ONLY.


SHEET INDEX	
S-001	TITLE PAGE
S-002	GENERAL NOTES SHEET
S-101	OVERALL FLOOR PLAN
S-102	OVERALL ROOF PLAN
S-103	ELEVATION DETAILS
S-104	ELEVATION DETAILS
S-105	ELEVATION DETAILS
S-500	WATERPROOFING DETAILS


REFERENCE	
OWNER	XX
ENGINEER	O'CONNELL & ASSOCIATES CONSULTING ENGINEERS, LLC 1394 CO HWY 283 S. BLDG #3 SANTA ROSA BEACH, FLORIDA 32459

OCONSULTING ENGINEERS, LLC.

T FOR CONSTRUCTION

EMERALD COAST
ONVENTION CENTER
SANTA ROSA BEACH

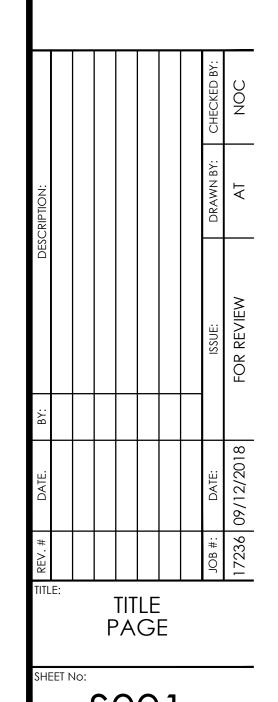

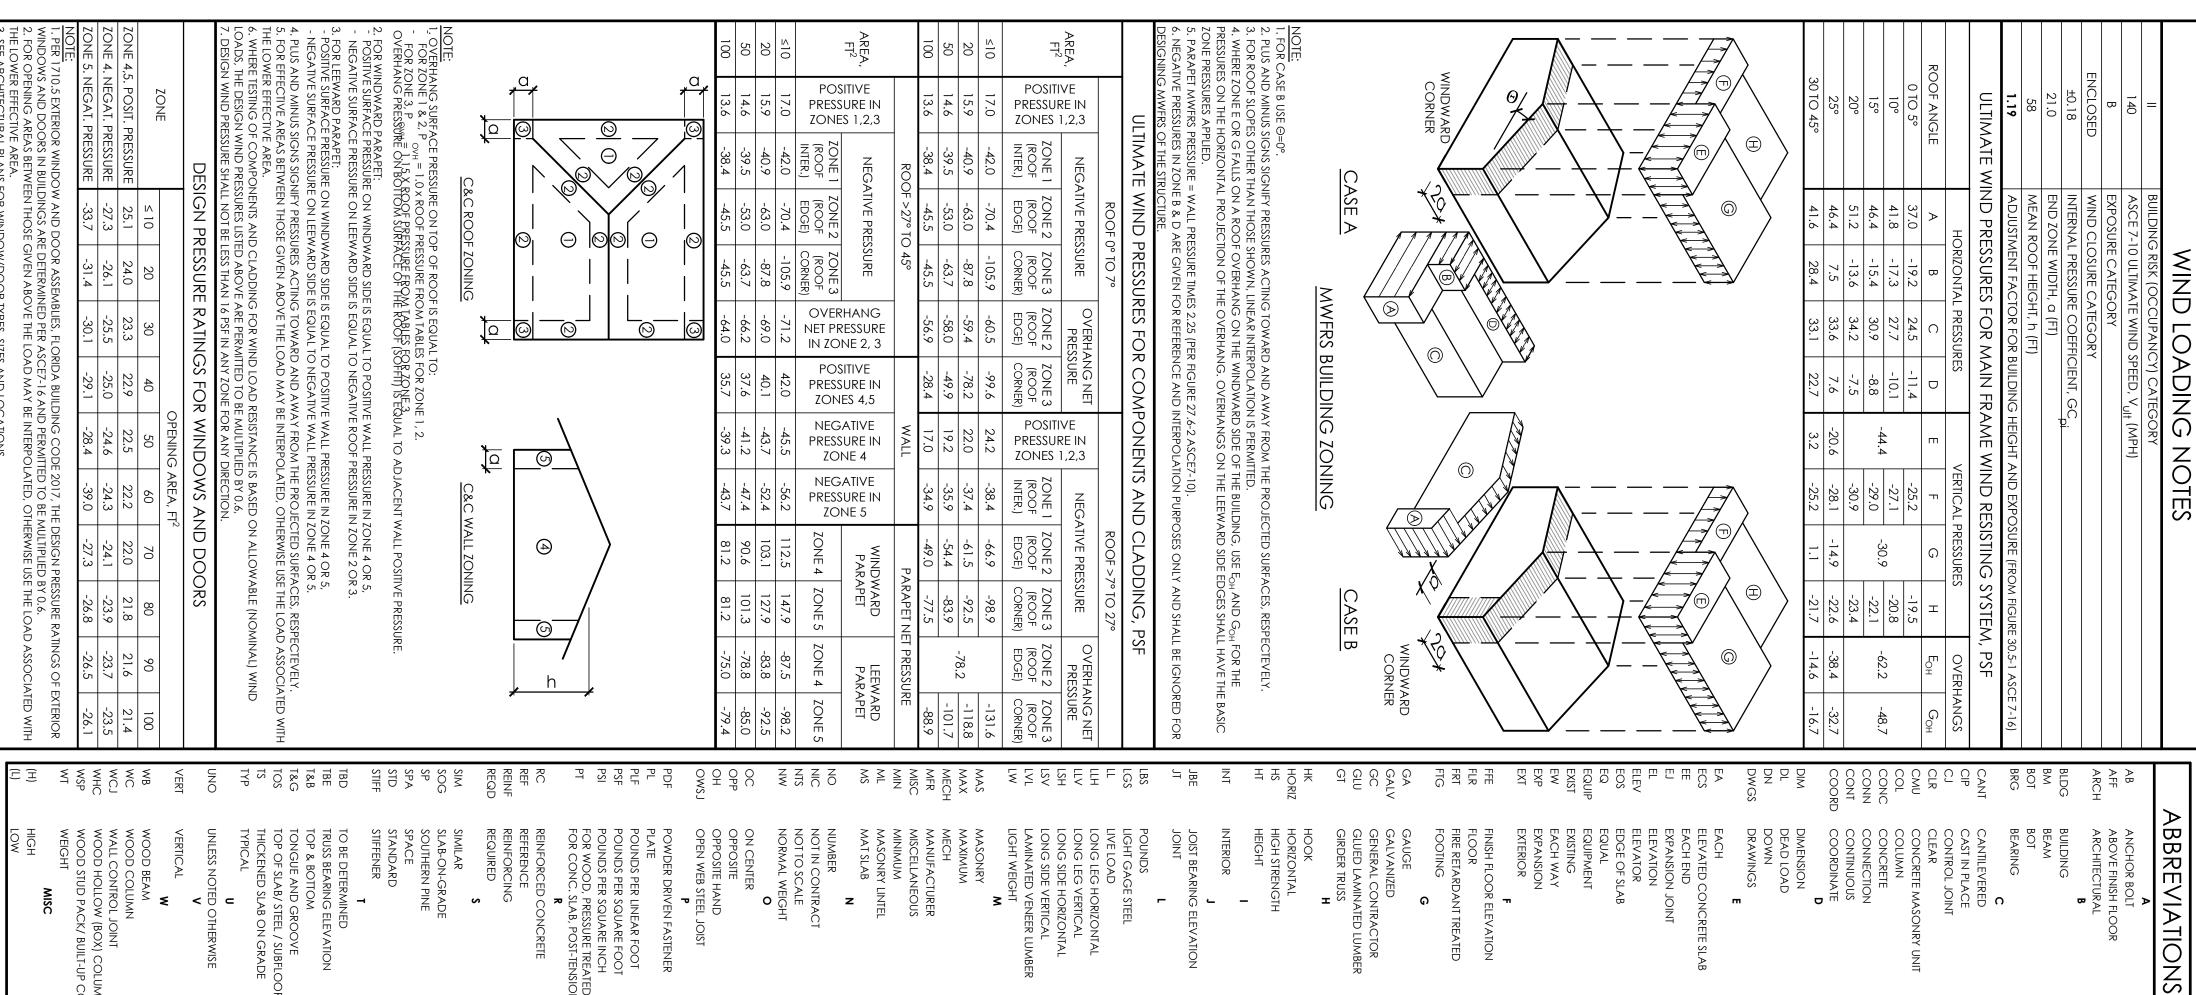

FLOOR MEMBERS: L/480

PLOOR MEMBERS: L/480

PL/360

WHERE, L = SPAN LENGTH (IN INCHES) BETWEEN CENTERLINES OF SUPPORTS THE CANTILEVER.)


CTIQ/386/IB/INGHES) A LIVE LOAD RS: L/480

CAST-IN-PLACE (NUTY - PERMANENTLY EXPOSED TO EARTH:
PERMANENTLY EXPOSED TO EARTH:
CAST AGAINST THE EARTH

AECHANICAL ANCHORS SHALL HAVE BEEN TESTED AND QUALIFIED FOR USE IN ACCORDANCE WITH ACI 355.2 (ND ICC-ES AC193 FOR CRACKED AND UNCRACKED CONCRETE RECOGNITION. PRE-APPROVED MECHANICAL (NCHORS INCLUDE: SIMPSON STRONG-TIE "TITEN-HD" (ICC-ES ESR-2713) (SIMPSON STRONG-TIE "STRONG-BOLT 2" (ICC-ES ESR-3037)

SIMPSON STRONG-TIE "SET-XP" (ICC-ES ESR-2508) HILTI HIT HY200 INJECTION ADHESIVE

# ONTRACTOR SHALL VERIFY EXISTING DIMENSIONS, ELEVATIONS, AND SITE CONDITIONS BEFORE STARTING WORK. RCHITECT/STRUCTURAL ENGINEER SHALL BE NOTIFIED OF ANY DISCREPANCY. 20 PSF DING AND DRIFT EFFECTS HAVE BEEN INCLUDED IN DESIGN DS: SEE TABLE CMU WALLS SHALL BE: \_AT EACH FLOOR LEVEL & TOP OF WALL @ 16'-0" O/C MAX., DOUBLE CMU BOND BEAMS REINFORCED W BOTTOM AND (2) #5 BARS ON TOP; - BETWEEN DOUBLE BOND BEAMS, SINGLE CMU BOND BEAM @ 4'-0" O/C REINFORCED WITH (1) #5 BAR. BOND BEAMS SHALL BE CONTINUOUS. CONTINUITY SHALL BE PROVIDED BY LAPPING SPLICES NOT LESS TI BENDING BARS AROUND CORNERS MIN. 30". STRUCTURAL STEEL EXPOSED TO WEATHER SHALL BE GALVANIZED, UNLESS OTHERWISE DIRECTED BY THE ENGINEER. STRUCTURAL STEEL SHALL BE FABRICATED AND ERECTED ACCORDING TO THE "LOAD AND RESISTANCE F SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS" AND THE AISC "CODE OF STANDARD PRACTICE FOR BRIDGES". CONCRETE MASONRY WORK SHALL CONFORM TO ACI 530/530.1-13, BUILDING FOR MASONRY STRUCTURES. provide horizontal Joint Reinforcement with no. 9 gage truss-type reinforcing wires at every alternative course (at 16" o/c), unless noted otherwise. Provide special accessories for corners, intersections, etc. OTHER STEEL SHAPES (CHANNELS, ANGLES, AND PLATES) MAY CONFORM TO ASTM A36. BOLTS, RODS, ANCHORS AND HEADED STUDS: ALL CONNECTIONS SHALL BE TIGHTENED USING "TURN-OF-NUT" METHOD WITH MINIMUM 3/4" DIAN HIGH-STRENGTH BOLTS.

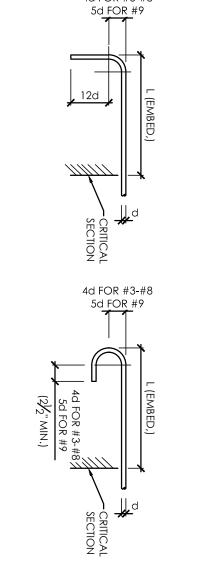

HOR RODS SHALL CONFORM TO ASTM A36 OR A307, UNLESS NOTED OTHERWISE.

DED STUDS SHALL BE 3/4" DIAMETER, UNLESS NOTED OTHERWISE, AND SHALL CONFORM TO AWS D1.1. LENGTH OF SHALL BE AS NOTED ON THE DRAWING.

ONS SHALL BE DETAILED BASED ON THE DESIGN INFORMATION PROVIDED IN THE CONTRACT DOCUMENTS.

FROM THE CONNECTION DETAILS DEPICTED IN THE CONTRACT DOCUMENTS SHALL NOT BE PERMITTED WITHOUT FROM THE STRUCTURAL ENGINEER.

SHALL BE DETAILED AS DOUBLE-ANGLE, SINGLE PLATE, SINGLE-WITH CONNECTION TABLES IN THE "MANUAL OF STEEL CONSTRUT".

ANGLE, OR TEE UCTION: LRFD",

C AND THE STRUCTURAL E QUALIFIED PRIOR TO

ARCHITECT OR

THIS BUILDING AND/OR STRUCTURE IS DESIGNED TO WITHSTAND ULTIMATE WIND VELOCITY OF 140 MPH ALSO, UPON COMPLETION OF THIS BUILDING AND/OR STRUCTURE, I WILL CERTIFY AT THAT TIME THE BUILDING AND/OR STRUCTURE HAS COMPLIED WITH THIS SPECIFIC BUILDING DESIGN. THIS MUST BE ON FILE AT THE WALTON COUNTY BUILDING DEPARTMENT BEFORE RECEIVING AN INSPECTION FOR POWER. I UNDERSTAND THAT ANY CHANGE IN DESIGN OR SPECIFICATION MUST BE SUBMITTED IN WRITING BY ME TO THE BUILDING DEPARTMENT.

BY: DESCRIPTION: DRAWN BY: CHECKED BY: FOR REVIEW NOC

GENERAL NOTES

DATE:

17236 09/12/2018

**S002** 

EMERALD COAST CONVENTION CENTER

& ASSOCIATES


CONSULTING ENGINEERS, LLC.


CERT. OF AUTH. #30549 1394 Co. Hwy. 283 S. Bldg. #3 Santa Rosa Beach FL, 32459 (850) 403-4555 www.oconnellengineers.com


H (2)#5 BARS ON


SANTA ROSA BEACH

WALTON COUNTY, FLORIDA

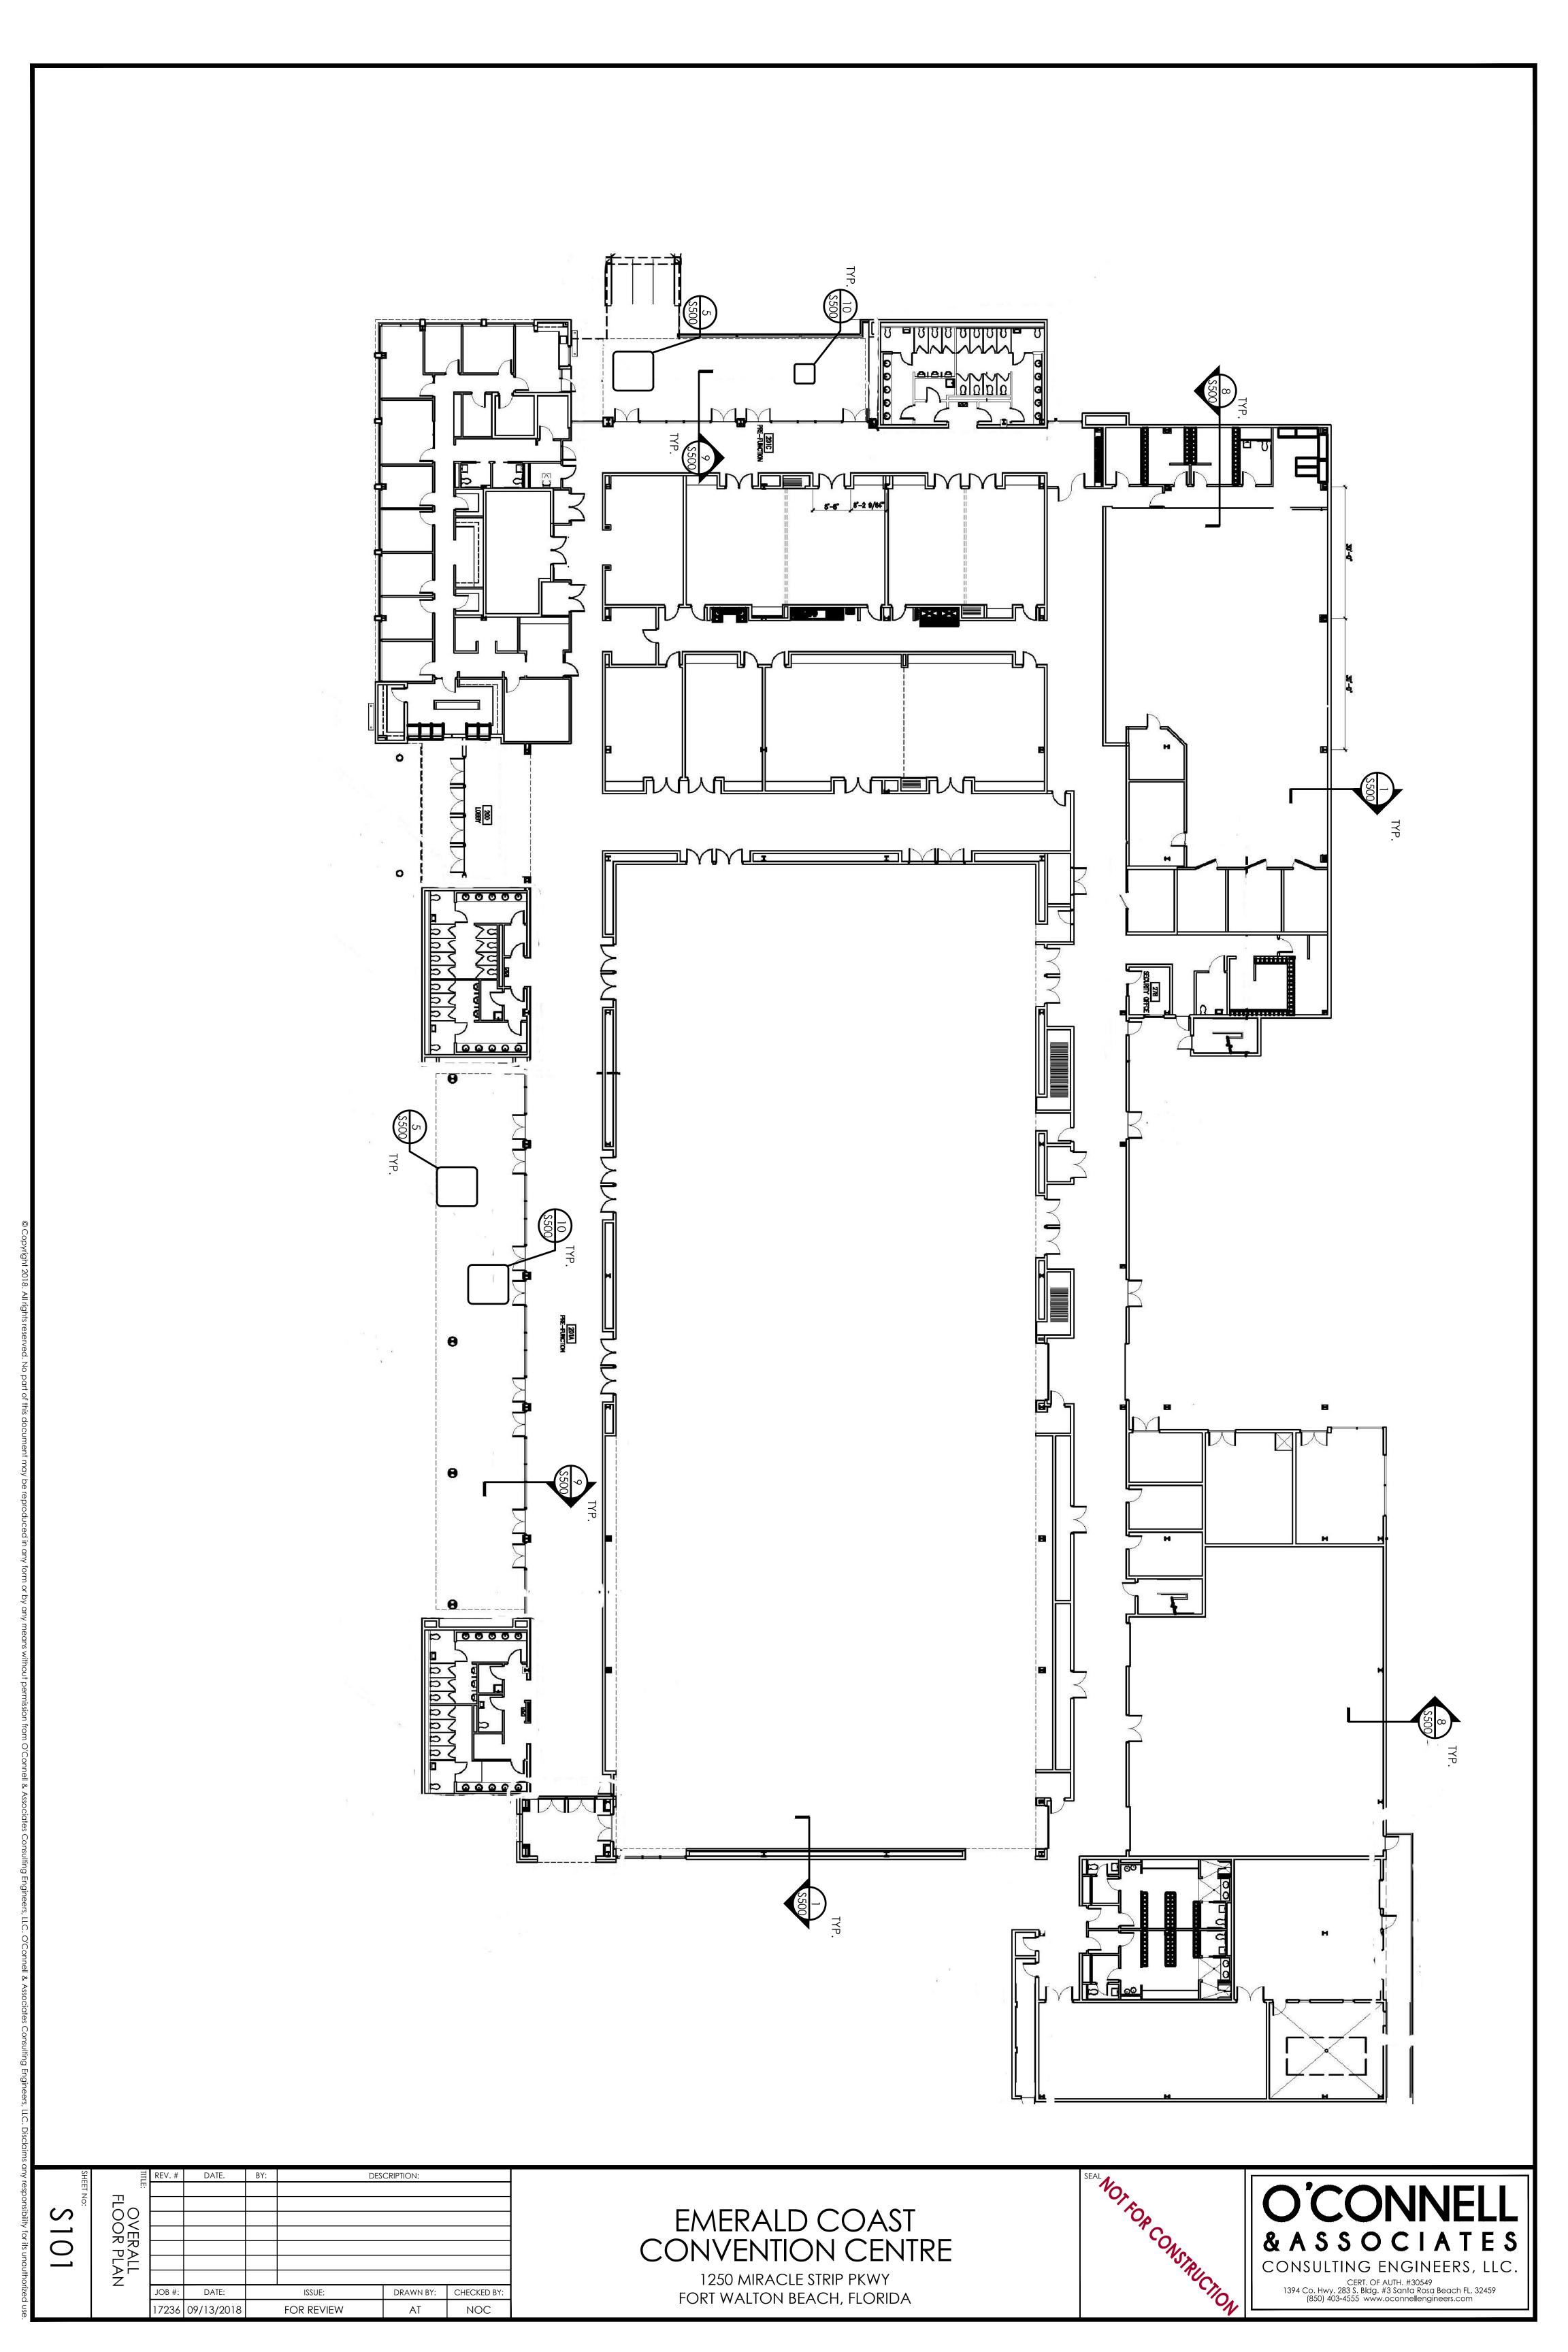

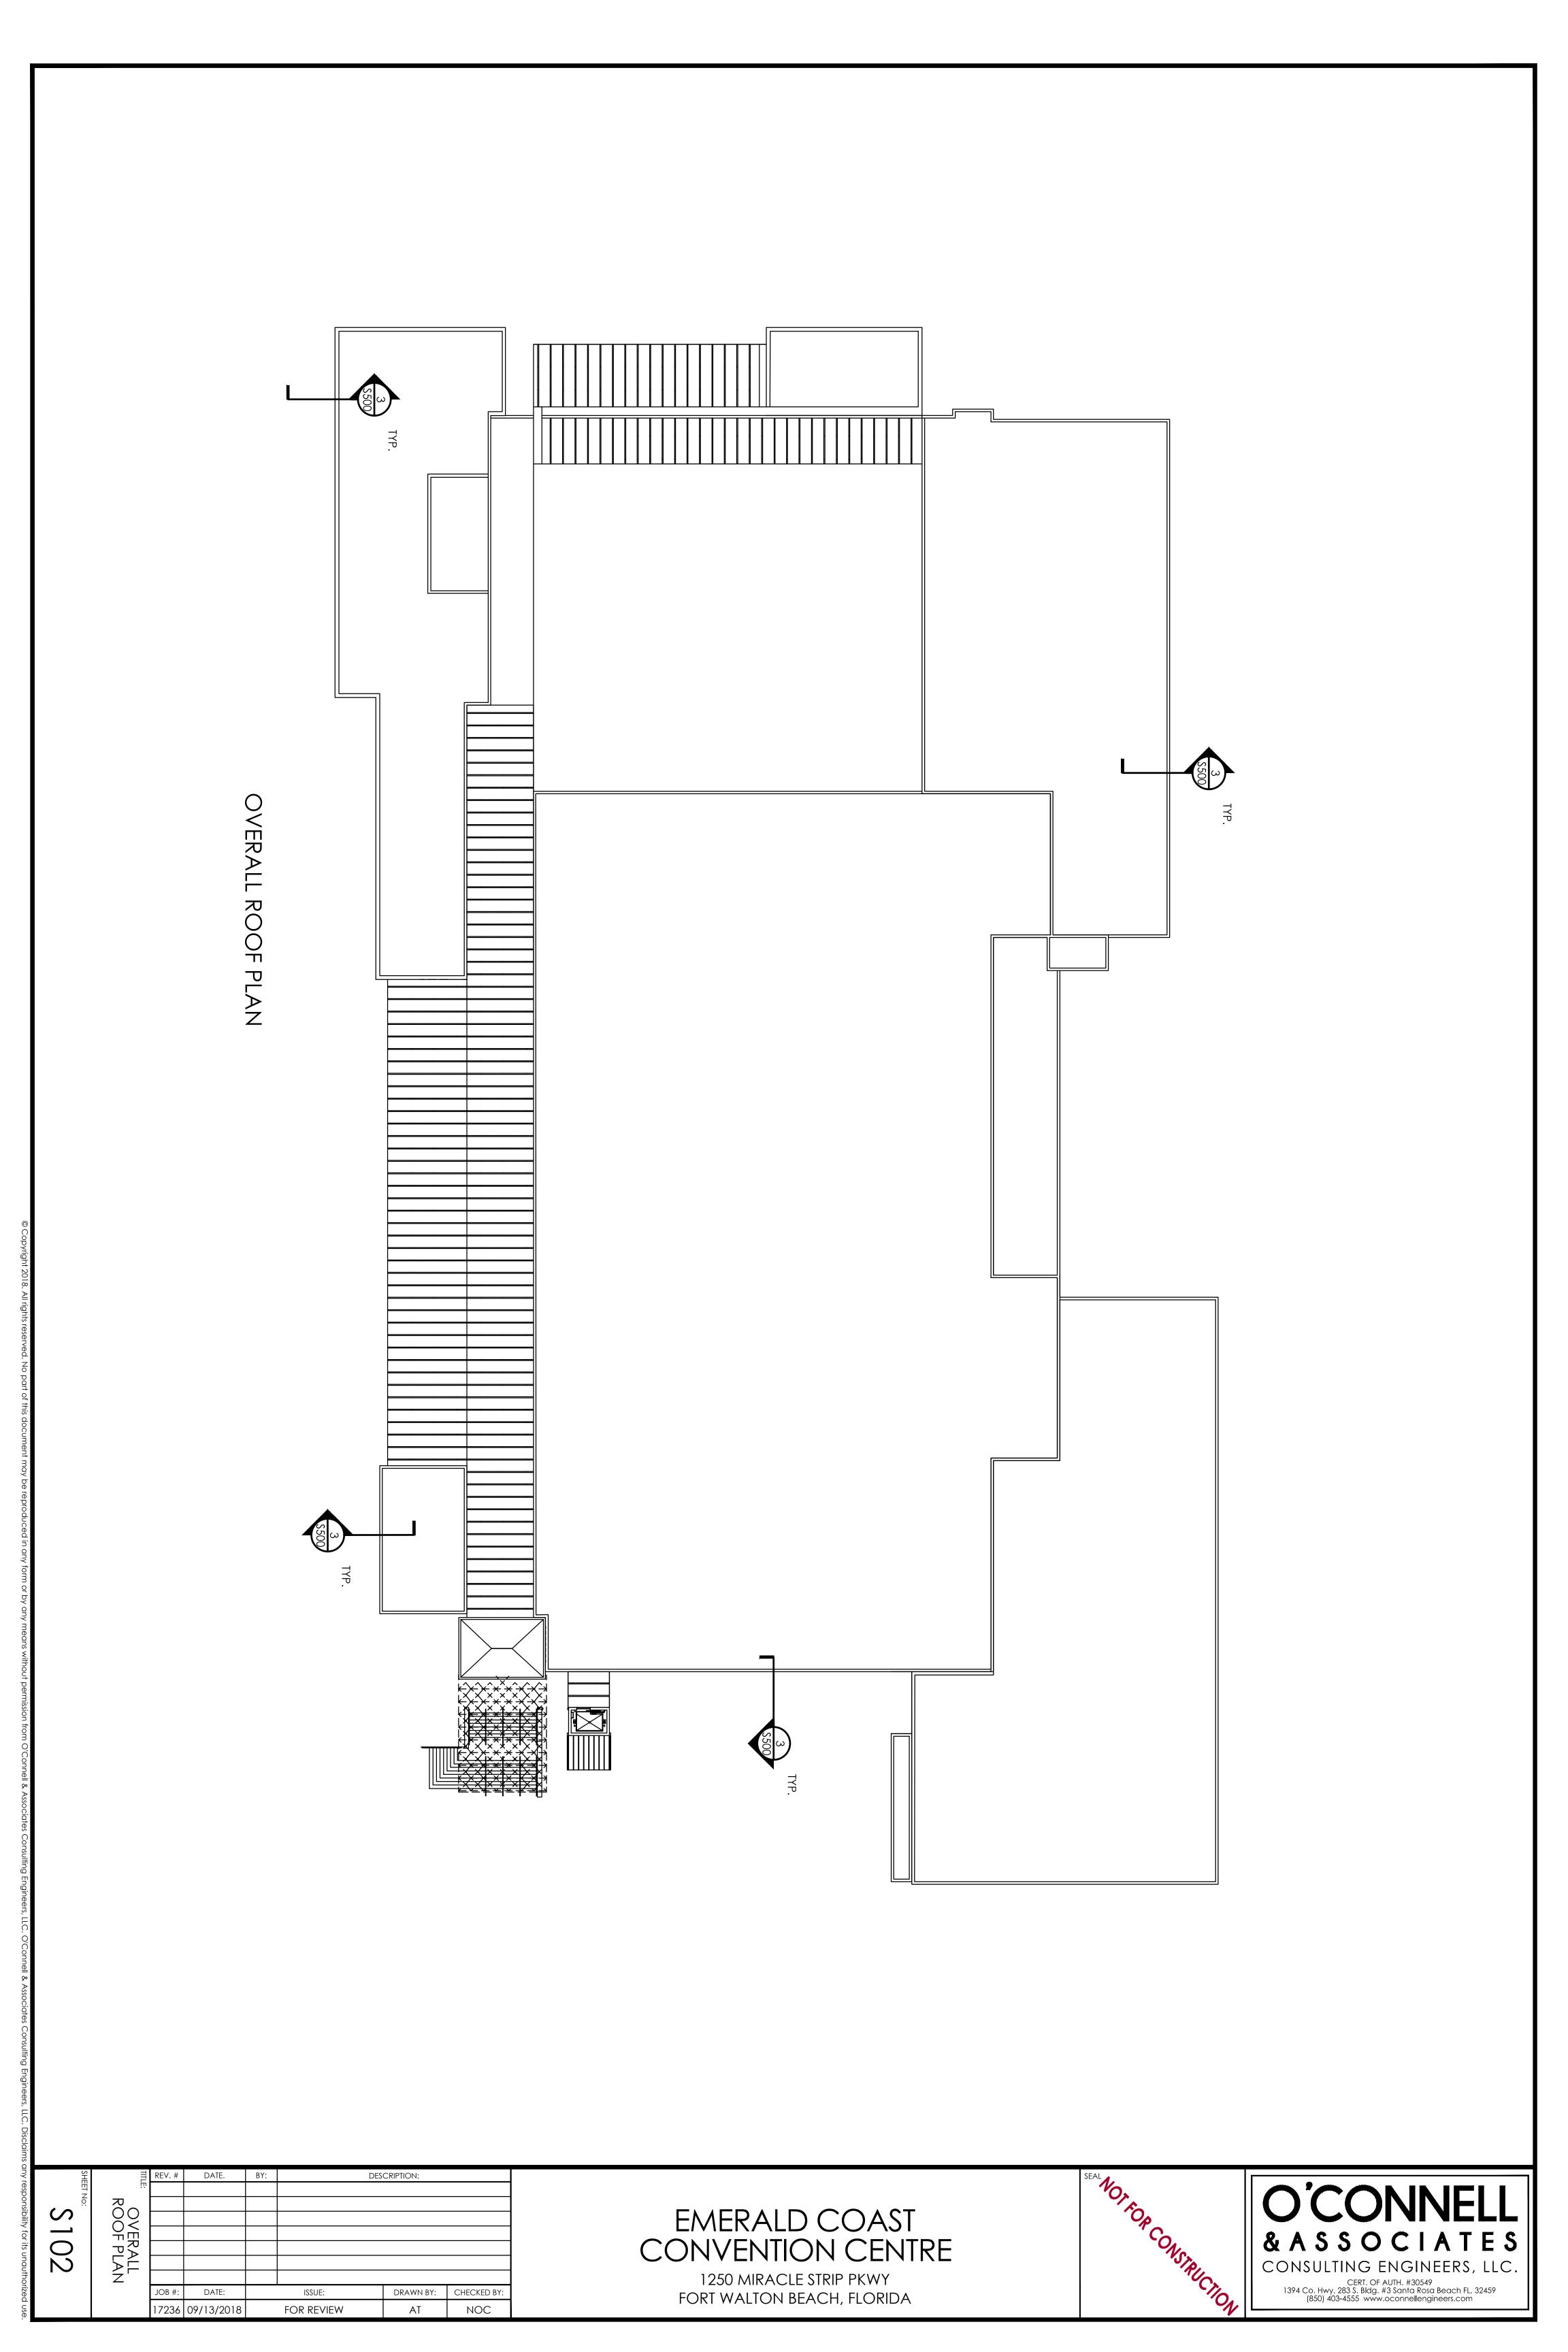

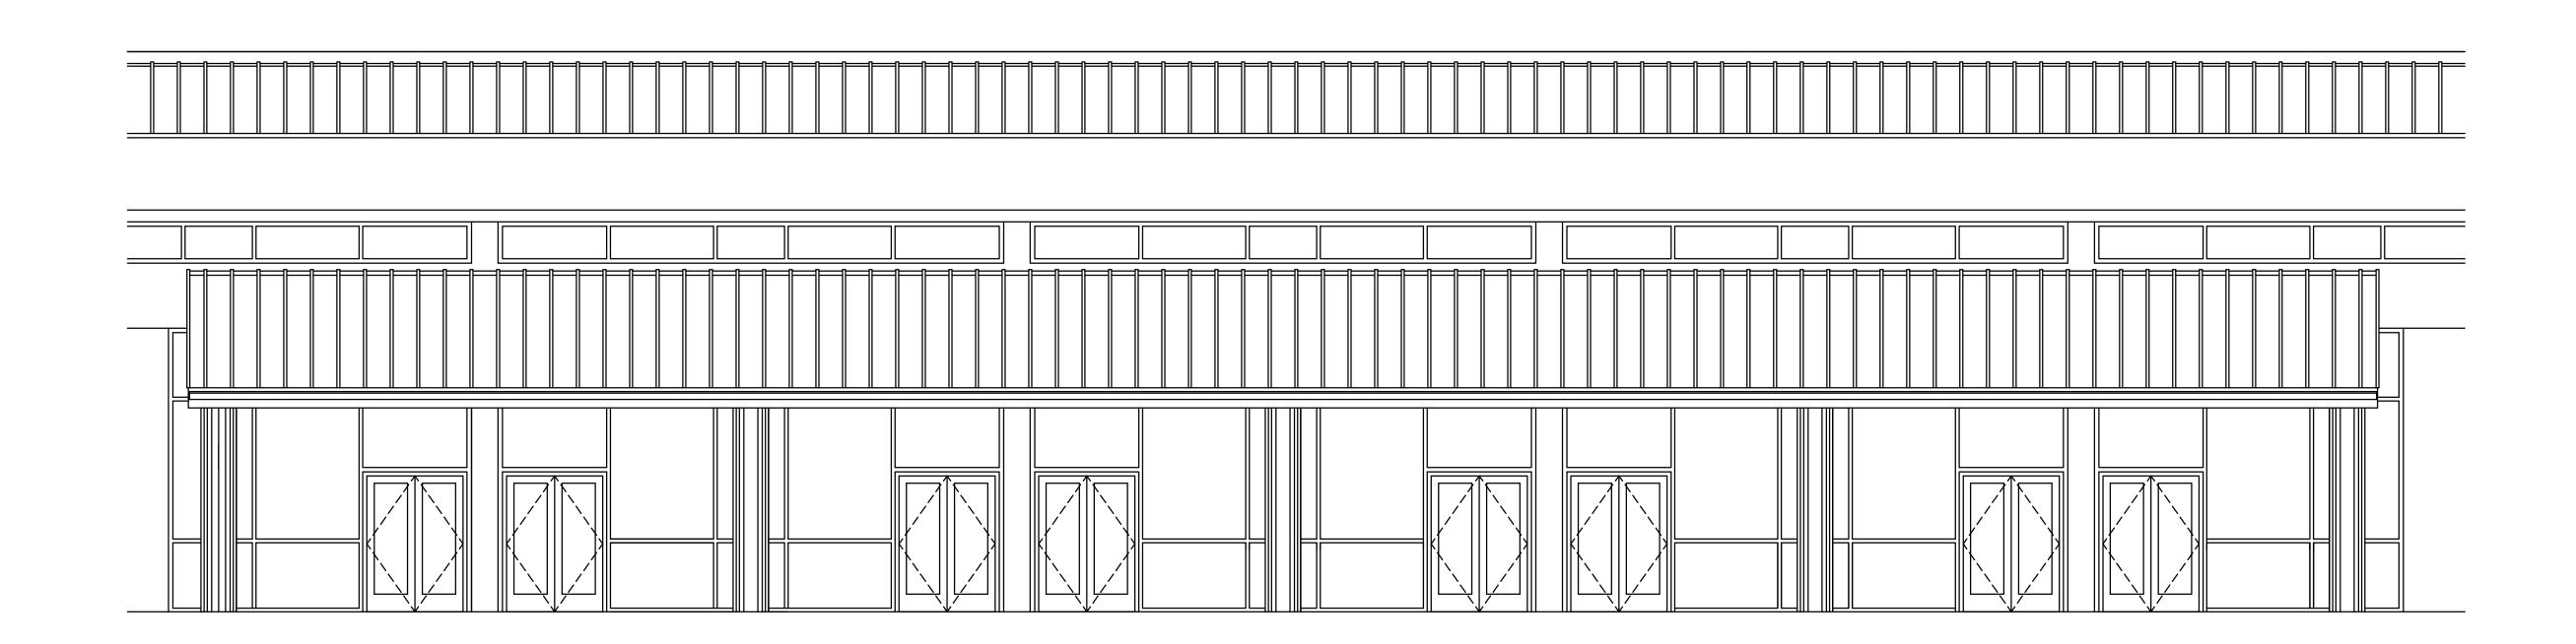

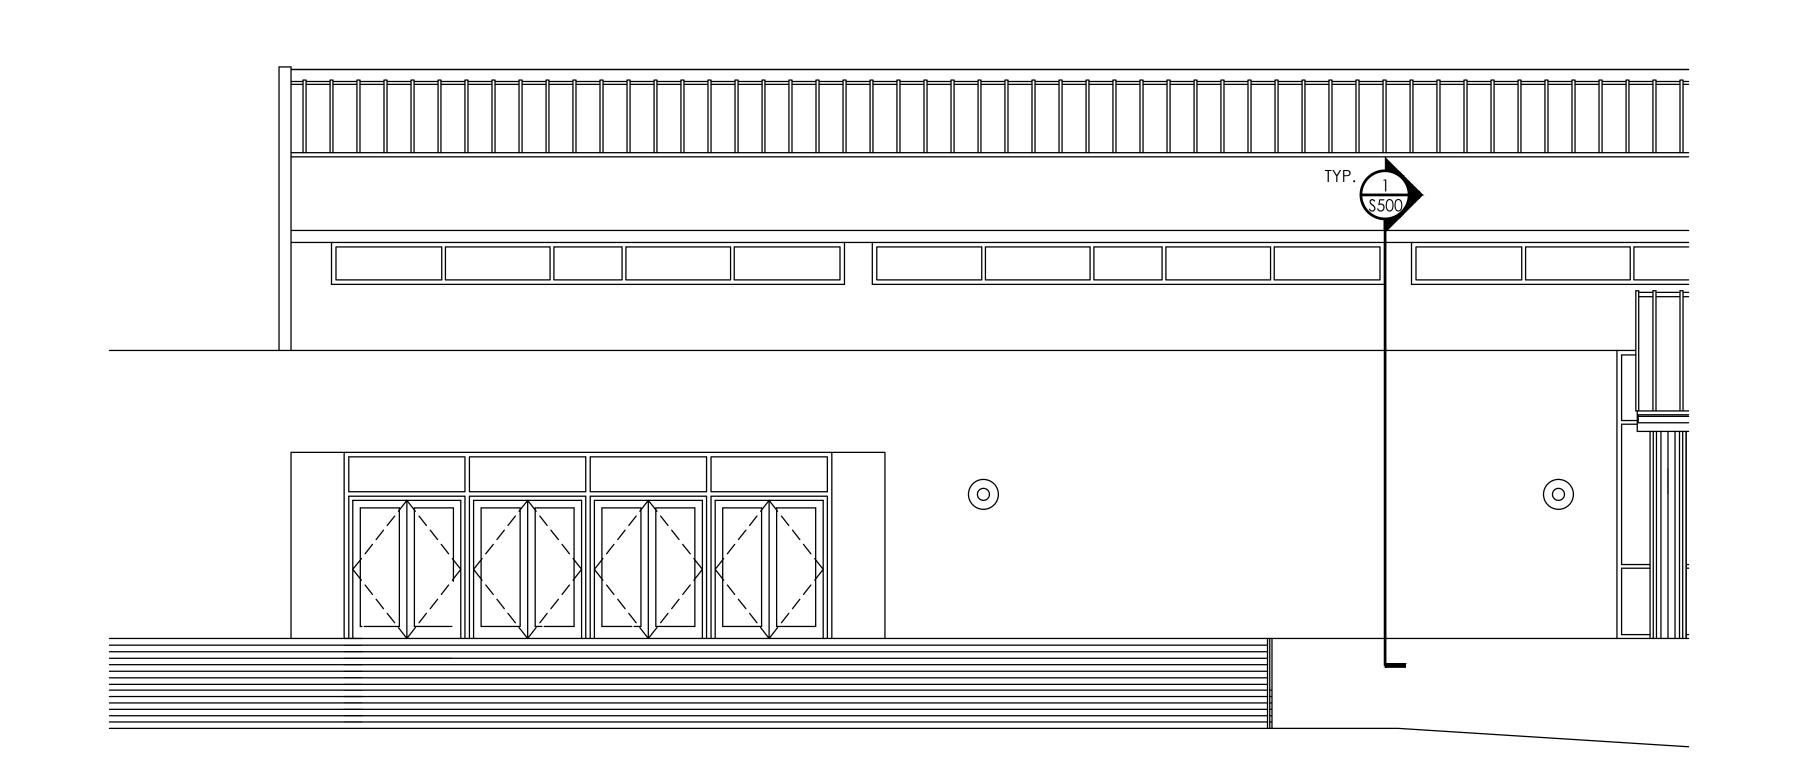

EAST ELEVATIONS

OCONSULTING ENGINEERS, L
CONSULTING ENGINEERS, L
CONSULTING ENGINEERS, L
CONSULTING ENGINEERS, L
CONSULTING ENGINEERS, L

OTFOR CONSTRUCT

EMERALD COAST
CONVENTION CENTRE
1250 MIRACLE STRIP PKWY
FORT WALTON BEACH, FLORIDA

ATE. BY: DESCRIPTION:

ATE: ISSUE: DRAWN BY: CHECKED BY:

3/2018 FOR REVIEW AT NOC

EAST ELEVATION DETAILS

\$103

